


1. Panel width shall not exceed 10 feet without a Contraction Joint.
2. Driveway to be one course concrete pavement.
3. 6" thick for residential drive, 8" thick for commercial drive and alley or specified.
4. Maximum driveway width = 30' with 3' tappers.
5. Minimum distance from lot line = 5', 25' between driveways.
6. Caps required on curbstops located in driveways.
7. The City must inspect twice, before placement of concrete and finish product.
8. Curb cut: structures must meet specifications of existing curb. Cut must be made at nearest joint and not between joints. The entire curb must be poured before the driveway.
9. Contraction joint: Must be installed between curb and driveway.
10. Front of Curb: Must be formed if blacktop is broken or jagged. Blacktop must be milled or saw cut and asphalt replaced to create a proper seal and uniform appearance.
11. Connected driveways must be approved by the city and be a minimum of 24' and a maximum of 60'.
12. Driveways must be at 90 degree angle to street, unless approved by the city.

DRIVEWAY SECTION
No Scale

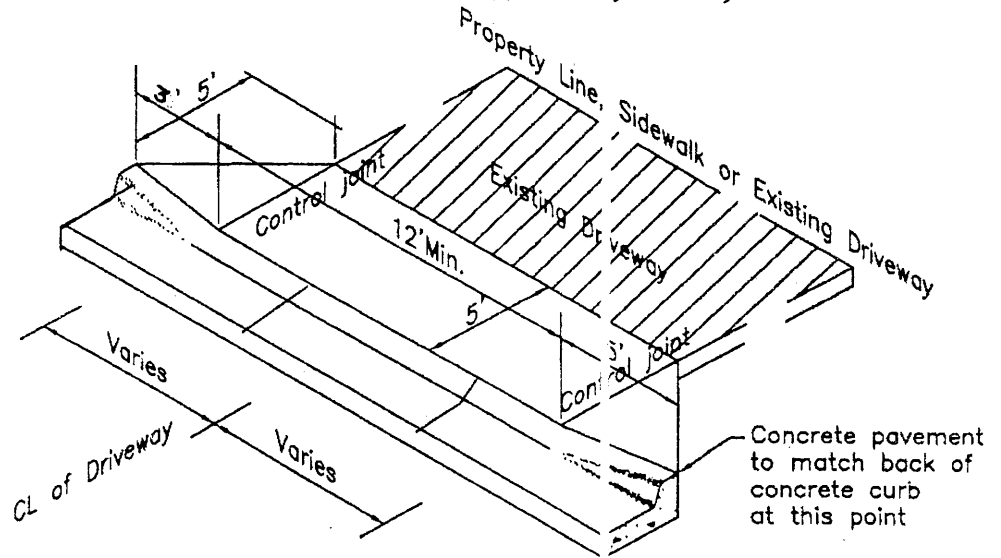

DRIVEWAY ISOMETRIC
No Scale

NOTE:
Control joints in concrete curb not to exceed 10' spacing through driveway section.

©  **Bonestroo
Rosene
Anderlik &
Associates**
Engineers & Architects
St Paul, Minnesota

STANDARD DETAILS
CONCRETE DRIVEWAY APRON

Last Revision:
March 2004

BRA Plate No.
4-4A

NEW PRAGUE, MINNESOTA

City Plate No.
STR-2